


BSK9

Rectangular Fire damper



FIRE SAFETY

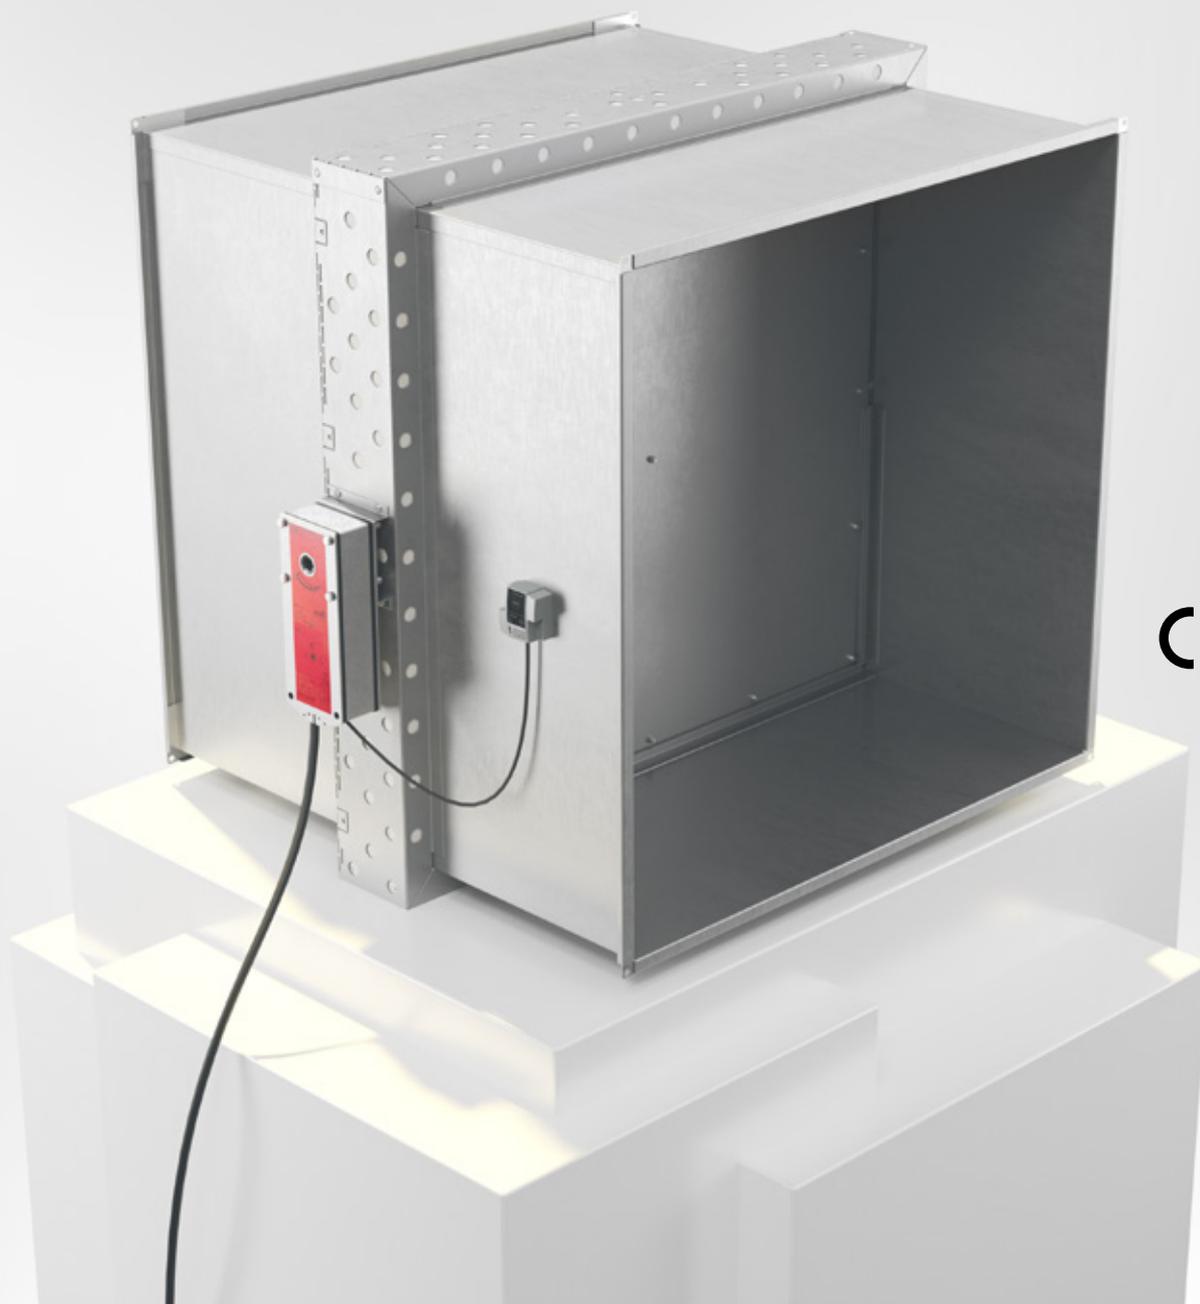

CE

02/04/2025



Quick facts

- Fire class EI90 / EI90S
- Sizes from 200 x 200 mm to 800 x 800 mm
- Fitted safety actuator 24 V or 230 V
- Low weight
- Easy installation
- CE-marked building product in acc. with EN 15650:2010
- Available in MagiCAD

Use

Damper in combination with walls or floors for ventilation fire protection in buildings. In accordance with the harmonised European Standard EN 15650:2010. In designs according to associated documents, installation instructions and when the damper is used in combination with smoke detectors and monitoring system (MRB, MRB3, FENIX), or the like, the spread of fire/combustion gases is prevented. No further action against the spread of fire/combustion gases is required.

Performance

CoCP (Certificate of Constancy of Performance) EN 15650:2010
0402-CPR-SC1299-13

Classification of fire resistance in accordance with EN13501-3
EI90 (ve ho i <-> o) S

For complete classification, refer to the Performance Declaration.



Installation

BSK9 is installed in fire cell separating walls or floors, according to the adjoining installation instructions. Should not be installed outdoors, in damp or high humidity areas.

Actuator

BSK9 is always supplied with an electric safety actuator with spring return complete with thermal sensor equipped with push button for local manual operating test. The sensor breaks the power supply to the actuator device if the temperature exceeds 72 °C inside or outside the damper. 24 V actuators are always used with the FENIX monitoring system, MRB3 and MRB. The damper can also be supplied with 230 V electric actuator. The damper is always supplied with a safety actuator.

Activation

The Boverket Building Regulations state a requirement for smoke detectors verified in accordance with SS-EN 54-7 for activation of dampers. The obligatory thermal sensor closes the damper at 72 °C in accordance with ISO 10294-4.

Control and monitoring

Dampers for protection against the spread of fire and combustion gases shall be closed via inputs from a smoke detector. Smoke detectors are mounted in ventilation ducts or monitored spaces. Fire dampers, smoke detectors and ventilation units are connected to the FENIX, MRB3 or MRB control unit for a complete ventilation fire protection. FENIX, MRB3 and MRB perform functional checks of the fire protection in accordance with current regulations. 3d party panels also possible. Please check compability first. See www.bevent-rasch.se for further details.



Size From 200 x 200 mm to 800 x 800 mm.

Design

The BSK9 comes complete with electrical safety actuator and thermal sensor. The actuator is maintenance-free and has integrated signal contacts for indication of the damper blade position. The standard version of the damper is supplied with a slip joint connection.

Material and surface finish

- Casing and details in hot-dip galvanized steel plate in accordance with environmental class C3.
- Blade sealing of fibre glass reinforced canvas.
- Blades and casing of calcium silicate.

Accessories

BRAS	Connection spigot for spiral duct
RBFS	Extension connection for walls/floors thicker than 280 mm, and in combination with BRAS or wire mesh grilles
RCKB	Junction box
RCDU	MRB-system, max 2 dampers
RCBK4	MRB-system, max 4 dampers
RCMU8	MRB-system, max 8 dampers
RCKD/-RD	Smoke detectors
BRTR	Wire mesh grille, rectangular
RCTU/RCTC	MRB3-system, max 236 dampers
FENIX2	max 2 dampers
FENIX4 / FENIX+	max 16 dampers

Specification

Example:

Fire damper **BSK9 - 400 - 400 - 1 - 1**

Size

Width x Height (W x H), mm

Material

Galvanized sheet steel = 1

Stainless EN 1.4404 = 3

Actuator

Electric 24V with thermal sensor = 1

Electric 230V with thermal sensor = 3

Electric 24V incl. RCTU = 5

Note Factory-fitted actuator device is always included.

Installation options for BSK9

Size	Fire class	Wall of drywall EI90 Group A, SS-EN1363-1	Solid wall	Solid Floor*
200 - 800 mm	EI90S	√	√	√

*125 mm lightweight concrete


Product data for BSK9

Size	Pressure class	Casing tightness SS-EN1751	Tightness over damper blades SS-EN1751	2-position actuator On-Off	Regulating actuator 0°-90°	Actuator type
200 - 800 mm	B	B	2	√	√	Belimo BFN-T

Pressure class B:
2500Pa



Dimensions and weight

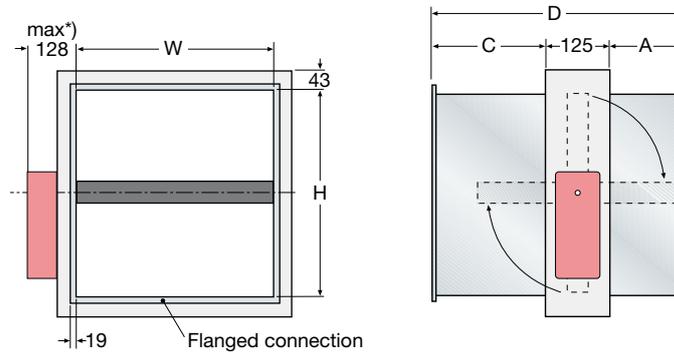

*) applies to standard design

Dimensions, mm

H	A	C	D
200	148	227	500
250	148	227	500
300	148	227	500
350	148	227	500
400	148	227	500
450	248	247	620
500	248	247	620
550	248	247	620
600	248	247	620
650	348	347	820
700	348	347	820
750	348	347	820
800	348	347	820


Weight incl. 24 V actuator, kg

H	W												
	200	250	300	350	400	450	500	550	600	650	700	750	800
200	12	13	15	16	17	18	22	23	24	26	27	29	30
250	13	15	16	17	18	20	23	24	26	27	29	30	32
300	15	16	17	18	20	21	24	26	27	29	30	32	34
350	16	17	18	20	21	22	26	27	29	30	32	34	35
400	17	18	20	21	22	24	27	29	30	32	34	35	37
450	20	22	23	25	27	28	32	34	36	37	39	40	41
500	22	23	24	27	28	29	33	36	37	39	40	42	43
550	23	24	26	28	29	30	34	37	39	40	42	46	44
600	24	26	27	29	30	32	35	39	40	42	43	48	46
650	29	30	32	33	35	36	39	43	45	47	48	51	52
700	30	31	33	35	36	37	41	44	47	48	50	52	54
750	31	32	35	36	37	39	42	46	48	50	51	54	55
800	32	34	36	37	39	40	43	47	50	51	53	55	57

Electrical data (values in brackets refer to 230 V)

Actuator type	BFN-T
Sizing, max	6 VA
Running time. - motor opening, max; - spring return, max	60 s 20 s at -10 to +55°C < 60 s at -30 to -10°C
Protection class	IP 54 in all installation positions
Supply voltage	24V~ ±20%, 50/60Hz 24V= ±10% (220-240V~, 50/60Hz)
Design	I _{max} 8,3A @ 5ms
Ambient temperature	-30° to +50°C
Thermal sensor tripping temperature	72°C
Mode contacts (Load)	1mA...3 (0,5 inductive) A, AC250V
Sound level when opening	< 43 dB (A)
Closing noise level	< 62 dB (A)
Maintenance	Maintenance-free

Wiring diagram

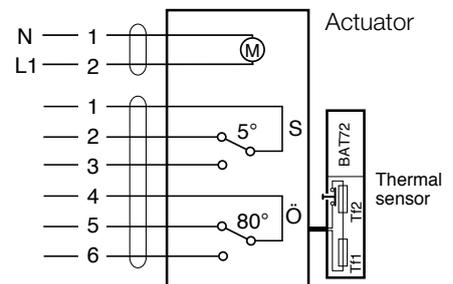


Illustrated in de-energised state




Accessories

Connection spigot
BRAS

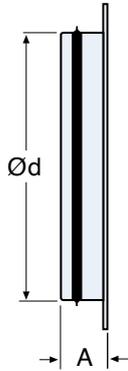



Extension spigot
RBFS

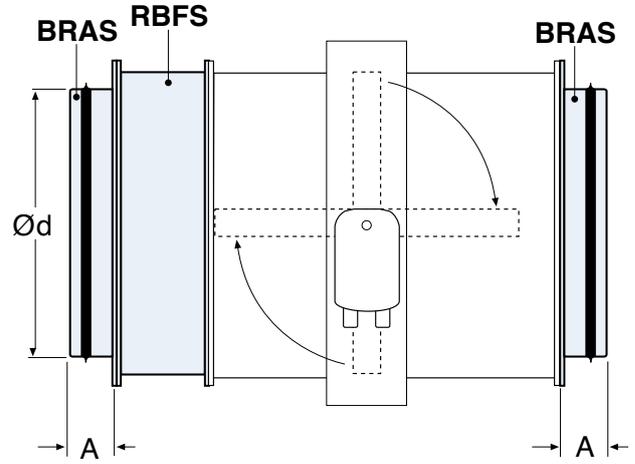

BRAS Ød	Min. damper size	A
100	200 x 200	50
125	200 x 200	50
160	200 x 200	50
200	200 x 200	50
250	250 x 250	50
315	350 x 350	65
400	400 x 400	80
500	500 x 500	80
630	650 x 650	80
800	800 x 800	80

Note! For circular dampers first use the BSKC9.

Mounting plate (included in delivery)

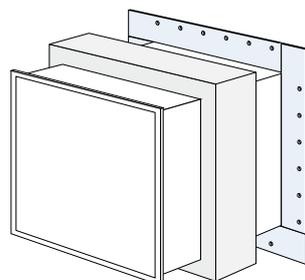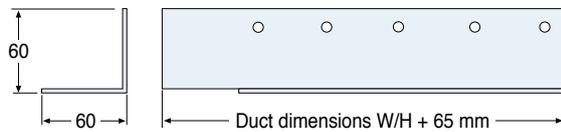

Supplied unassembled




Technical data

Sound data

The speed is calculated on the damper's gross area, i.e.

one BSK9 - 400 x 400 has a gross area of 0.16 m².

The specified pressure drop applies to the damper without accessories.

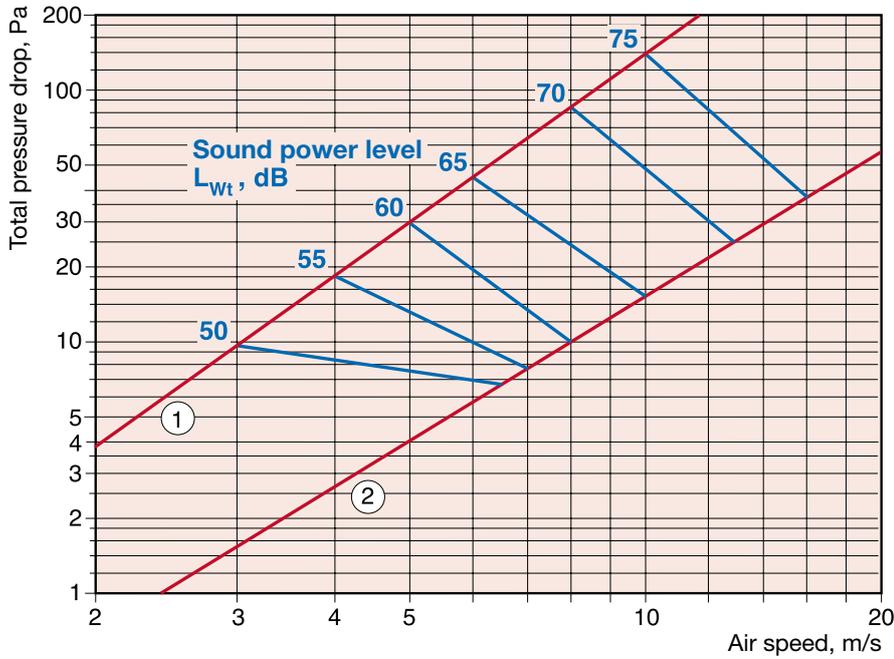

- ① Damper height < 400 mm
- ② Damper height H ≥ 400 mm

Correction of sound power level, L_{Wt} , for different sizes use curves ① - ② according to: $L_W = L_{Wt} + K_1$

Damper height mm	Damper area, m ²				
< 400 acc. to ①	-	0,08	0,16	0,28	-
≥ 400 acc. to ②	0,08	0,16	0,32	0,64	1,28
K_1	-3	0	3	6	9

Correction of sound power level, L_{Wok} , in octave band


$$L_{Wok} = L_W + K_{ok}$$

Correction, K_{ok}

Opening angle	Centre frequency Hz							
	63	125	250	500	1000	2000	4000	8000
90°	-1	-11	-18	-23	-26	-28	-32	-38
Tol. ± dB	1	2	3	4	6	6	6	6



Installation instructions

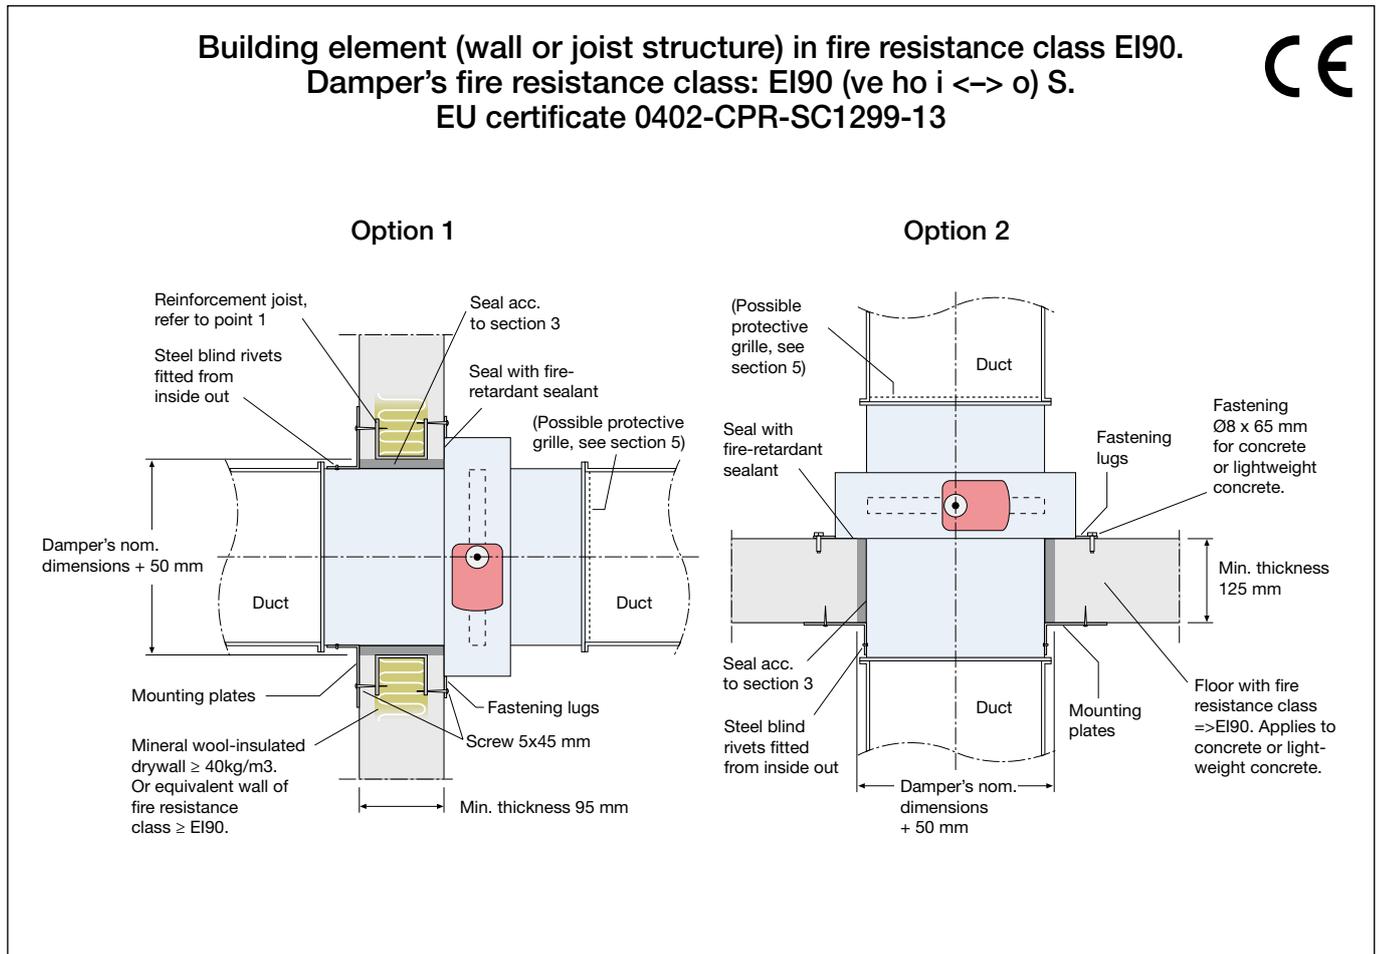

Options 1 and 2

1. Create a hole, corresponding to the damper's nominal dimensions + 50 mm, in the building element.
If installing in plasterboard, a steel reinforcement frame of 45x45 must be used.
2. The damper is secured flat and tight using fire-retardant sealant between the damper and wall/joist structure with all fastening lugs, which are opened out.
Screw $\text{Ø} 5 \text{ mm}$ with a minimum length of 45 mm to be used when mounting in drywall. The screw is pulled through the reinforcement stud.
3. Check that the gap between the damper and the wall is 25 mm all the way round. Sealing is carried out by caulking with mineral wool, min 40 kg/m^3 .
4. Fit the mounting plates against the substrate with suitable fixings. Now fasten the mounting plates on the damper with steel blind rivets $\text{Ø} 5 \text{ mm}$ through the pre-punched holes in the mounting plates. Fit with blind rivets from inside out. Ensure that the damper blade runs freely.
5. When using a Fire damper as a transfer-air or end device, a non-combustible louvre intended for the damper must be mounted on the non-connected sides of the damper.
The minimum distance between the damper blade in the open position and the louvre is 50 mm.
6. Connect the actuator device to the control unit and carry out a function check.
7. Install the duct system according to applicable requirements. Ensure that connecting ducts systems do not affect dampers during fire loading.
 - The shortest distance between dampers must be 200 mm.
 - The shortest distance to wall/floor must be 75 mm.
 - The damper shaft must be mounted horizontally.